


Figure 4 - Tested Sites for West Lakes

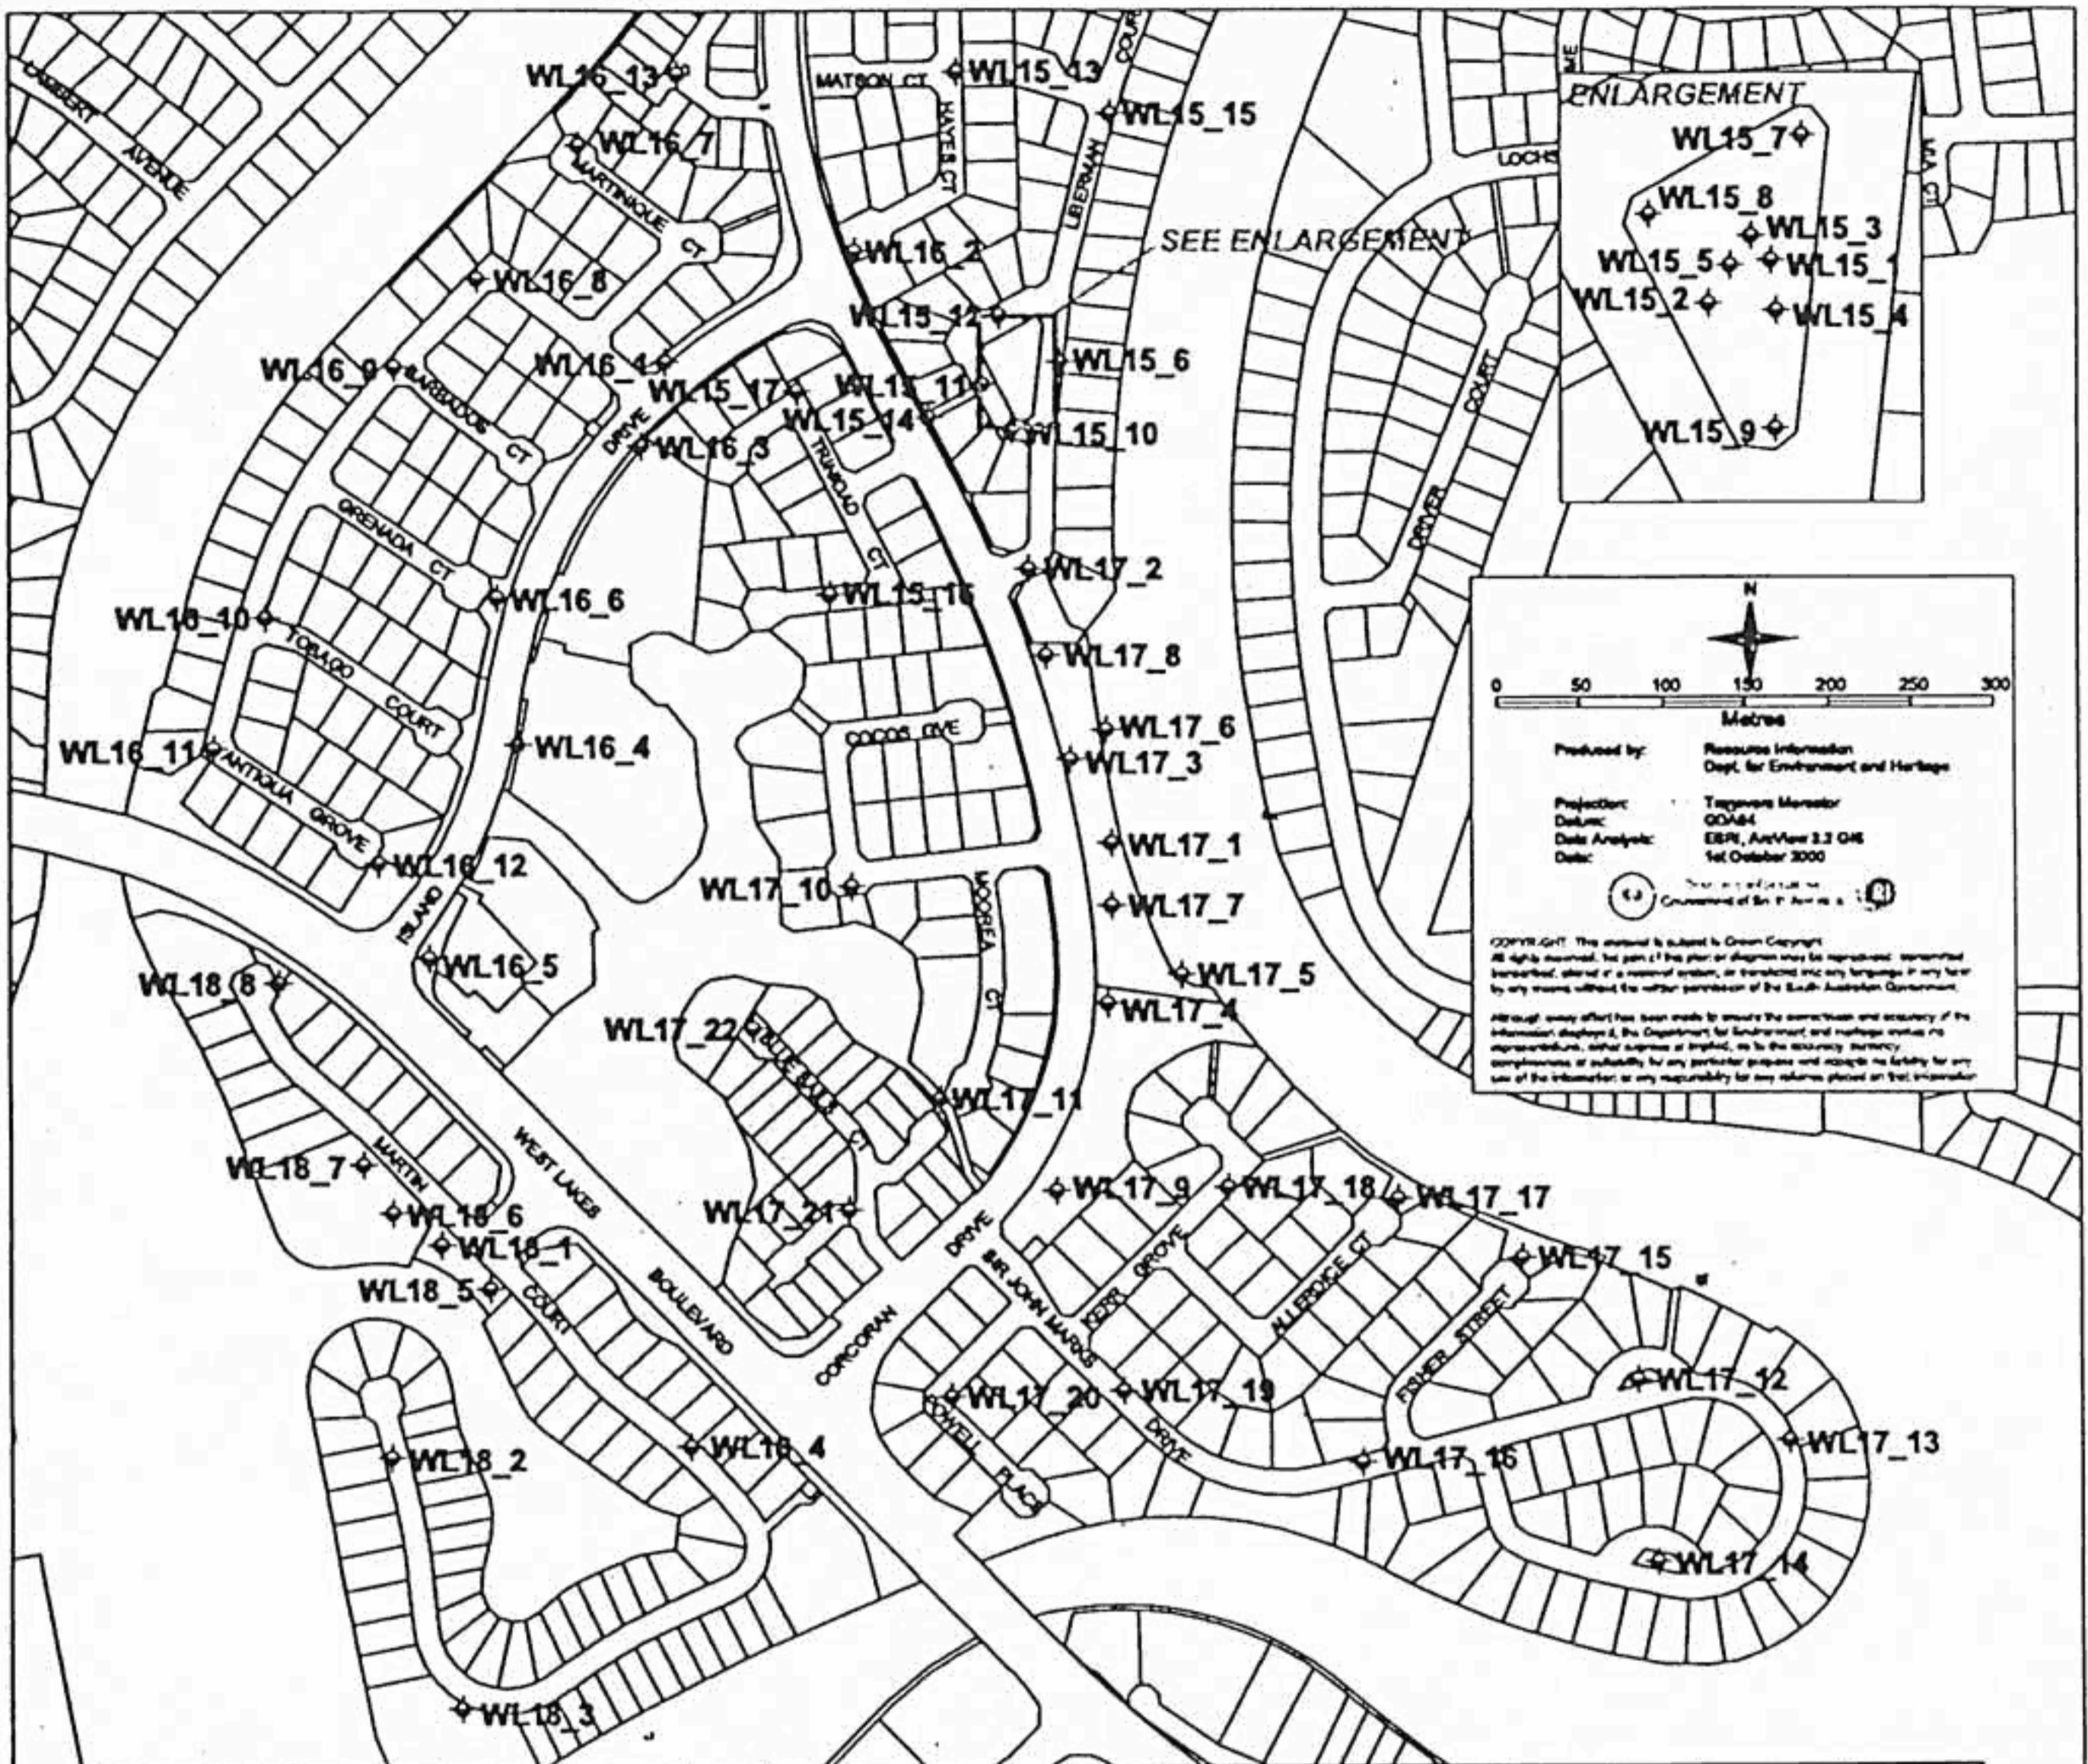

BORE-NAME	SAMPL. NO.	SAMPLE DEPTH (m)	CADMIUM (mg/kg)	BORE-NAME	SAMPL. NO.	SAMPLE DEPTH (m)	CADMIUM (mg/kg)	BORE-NAME	SAMPL. NO.	SAMPLE DEPTH (m)	CADMIUM (mg/kg)	BORE-NAME	SAMPL. NO.	SAMPLE DEPTH (m)	CADMIUM (mg/kg)
WL15_1	1	0.0-0.1	8	WL15_16	1	0.0-0.1	1.2	WL17_2	1	0.0-0.1	<0.5	WL17_17	1	0.1-0.35	0.8
	2	0.3-0.4	160		2	0.1-0.35	0.9		2	0.1-0.35	<0.5		2	0.35-0.45	0.8
	3	0.4-0.6	4		3	0.35-0.45	1		3	0.35-0.55	<0.5		3	0.45-0.55	1.2
WL15_2	1	0.0-0.2	1.2		4	0.45-0.6	1.2	WL17_3	1	0.0-0.17	<0.5	WL17_18	1	0.0-0.1	0.7
	2	0.2-0.3	6		1	0.0-0.1	1		2	0.2-0.5	<0.5		2	0.1-0.23	0.8
	3	0.3-0.4	140	WL15_17	2	0.1-0.25	0.9	WL17_4	1	0.0-0.1	0.9		3	0.25-0.4	0.8
	4	0.4-0.5	3.8		3	0.35-0.45	0.6		2	0.1-0.3	0.9		4	0.4-0.5	0.8
WL15_3	1	0.0-0.1	20		1	0.0-0.15	<0.5	WL17_5	3	0.3-0.5	0.7	WL17_19	1	0.05-0.2	0.8
	2	0.1-0.2	0.9	WL16_1	2	0.15-0.3	<0.5		1	0.05-0.15	0.5		2	0.2-0.35	0.9
	3	0.2-0.35	160		3	0.3-0.45	<0.5	WL17_6	2	0.15-0.25	<0.5		3	0.35-0.5	0.9
	4	0.35-0.5	3.4	WL16_2	1	0.0-0.15	<0.5		3	0.25-0.3	<0.5	WL17_20	1	0.05-0.2	0.8
WL15_4	1	0.0-0.05	1.4		2	0.2-0.5	<0.5	WL17_7	4	0.3-0.5	<0.5		2	0.2-0.4	0.7
	2	0.05-0.25	91	WL16_3	1	0.0-0.1	1.6		1	0.0-0.1	<0.5		3	0.4-0.55	0.6
	3	0.25-0.4	<0.5		2	0.1-0.2	1.2	WL17_8	2	0.15-0.3	<0.5	WL17_21	1	0.05-0.25	0.8
	4	0.4-0.5	9	WL16_4	3	0.2-0.3	<0.5		3	0.3-0.5	<0.5		2	0.25-0.4	0.6
WL15_5	1	0.0-0.1	11		1	0.0-0.1	<0.5	WL17_9	1	0.0-0.2	0.8		3	0.4-0.55	0.6
	2	0.1-0.3	10	WL16_5	2	0.1-0.3	<0.5		2	0.2-0.3	0.7	WL17_22	1	0.0-0.15	0.8
	3	0.35-0.5	3.4		3	0.45-0.55	<0.5	WL17_10	3	0.3-0.5	1		2	0.15-0.3	0.9
WL15_6	1	0.0-0.15	<0.5	WL16_6	1	0.0-0.15	<0.5		1	0.0-0.1	0.8		3	0.45-0.55	0.9
	2	0.15-0.3	<0.5		2	0.15-0.3	<0.5	WL17_11	2	0.15-0.3	0.6	WL18_1	1	0.0-0.15	<0.5
	3	0.3-0.45	<0.5	WL16_7	3	0.35-0.45	<0.5		3	0.35-0.5	0.7		2	0.15-0.3	<0.5
	4	0.45-0.55	<0.5		4	0.5-0.6	<0.5	WL17_12	1	0.0-0.15	1.2		3	0.3-0.45	<0.5
WL15_7	1	0.0-0.1	2	WL16_8	1	0.0-0.1	0.7		2	0.15-0.3	1.4	WL18_2	1	0.0-0.1	1.4
	2	0.1-0.5	<0.5		2	0.1-0.2	0.9	WL17_13	3	0.3-0.5	0.6		2	0.1-0.25	0.9
WL15_8	1	0.0-0.25	25	WL16_9	3	0.2-0.3	0.6		1	0.0-0.1	<0.5		3	0.45-0.55	1
	2	0.25-0.5	<0.5		1	0.0-0.15	<0.5	WL17_14	2	0.1-0.15	0.8	WL18_3	1	0.0-0.15	0.8
WL15_9	1	0.0-0.1	7.8	WL16_10	2	0.15-0.3	<0.5		3	0.15-0.3	1		2	0.2-0.3	0.8
	2	0.1-0.3	25		3	0.4-0.5	<0.5	WL17_15	4	0.3-0.4	0.8		3	0.38-0.5	0.5
	3	0.3-0.5	<0.5	WL16_11	1	0.1-0.25	0.6		1	0.0-0.15	0.7	WL18_4	1	0.0-0.15	0.9
	4	0.4-0.5	<0.5		2	0.15-0.4	0.6	WL17_16	2	0.15-0.25	0.9		2	0.2-0.35	1.6
WL15_10	1	0.0-0.1	<0.5	WL16_12	3	0.4-0.55	1.8		3	0.3-0.35	0.9	WL18_5	3	0.4-0.5	1
	2	0.12-0.35	<0.5		1	0.1-0.2	1.2	WL17_17	4	0.5-0.6	0.8		1	0.0-0.15	0.7
	3	0.35-0.5	<0.5	WL16_13	2	0.2-0.35	0.6		5	0.75-0.85	<0.5		2	0.15-0.35	0.7
	4	0.4-0.5	<0.5		3	0.35-0.5	0.6	WL17_18	1	0.0-0.15	1.4		3	0.35-0.5	1.2
WL15_11	1	0.0-0.14	<0.5	WL16_14	1	0.0-0.1	<0.5		2	0.15-0.3	0.7	WL18_6	1	0.0-0.15	0.8
	2	0.15-0.5	<0.5		2	0.1-0.2	0.7	WL17_19	3	0.3-0.4	0.8		2	0.2-0.35	0.8
	3	0.5-0.6	<0.5	WL16_15	3	0.35-0.5	<0.5		4	0.4-0.5	1		3	0.35-0.5	0.6
WL15_12	1	0.0-0.15	<0.5		1	0.0-0.2	<0.5	WL17_20	1	0.0-0.15	0.7	WL18_7	1	0.0-0.15	0.9
	2	0.2-0.4	<0.5	WL16_16	2	0.2-0.4	<0.5		2	0.2-0.4	0.6		2	0.15-0.35	1.2
	3	0.35-0.5	<0.5		3	0.4-0.5	<0.5	WL17_21	3	0.43-0.55	0.9		3	0.37-0.5	0.9
WL15_13	1	0.0-0.1	<0.5	WL16_17	1	0.05-0.2	<0.5		1	0.05-0.2	0.8	WL18_8	1	0.0-0.15	0.6
	2	0.1-0.25	<0.5		2	0.2-0.35	<0.5	WL17_22	2	0.2-0.35	0.9		2	0.15-0.3	0.5
	3	0.25-0.5	<0.5	WL16_18	3	0.35-0.5	<0.5		3	0.35-0.55	0.8		3	0.3-0.5	0.6
WL15_14	1	0.0-0.15	<0.5		1	0.0-0.2	<0.5	WL17_23	1	0.0-0.15	0.6		1	0.0-0.15	0.9
	2	0.15-0.3	<0.5	WL16_19	2	0.2-0.4	<0.5		2	0.15-0.35	0.8		2	0.15-0.35	1.2
	3	0.3-0.4	<0.5		3	0.4-0.5	<0.5	WL17_24	3	0.35-0.5	0.8		3	0.3-0.5	0.6
	4	0.4-0.5	<0.5	WL16_20	1	0.0-0.2	<0.5		1	0.0-0.15	0.6		1	0.0-0.15	0.9
	5	0.5-0.6	<0.5		2	0.2-0.4	<0.5	WL17_25	2	0.15-0.35	0.8		2	0.15-0.35	1.2
WL15_15	1	0.0-0.15	<0.5	WL16_21	3	0.4-0.5	<0.5	WL17_26	3	0.35-0.5	0.8		3	0.3-0.5	0.6
	2	0.15-0.3	<0.5		1	0.0-0.15	<0.5		1	0.0-0.13	0.8		1	0.0-0.15	0.6
	3	0.3-0.4	<0.5	WL16_22	2	0.15-0.3	<0.5	WL17_27	2	0.15-0.3	0.9		2	0.15-0.3	0.5
	4	0.4-0.5	<0.5		3	0.3-0.45	<0.5		3	0.3-0.5	0.6		3	0.3-0.5	0.6
	5	0.5-0.6	<0.5	WL16_23	1	0.0-0.15	<0.5		1	0.0-0.13	0.8		1	0.0-0.15	0.6
					2	0.15-0.3	<0.5	WL17_28	2	0.15-0.3	0.9		2	0.15-0.3	0.5
					3	0.3-0.45	<0.5		3	0.3-0.5	0.6		3	0.3-0.5	0.6